


TOP KNOWN CAUSES OF SPILLS AT FIXED FACILITIES

National Response Center, 2014

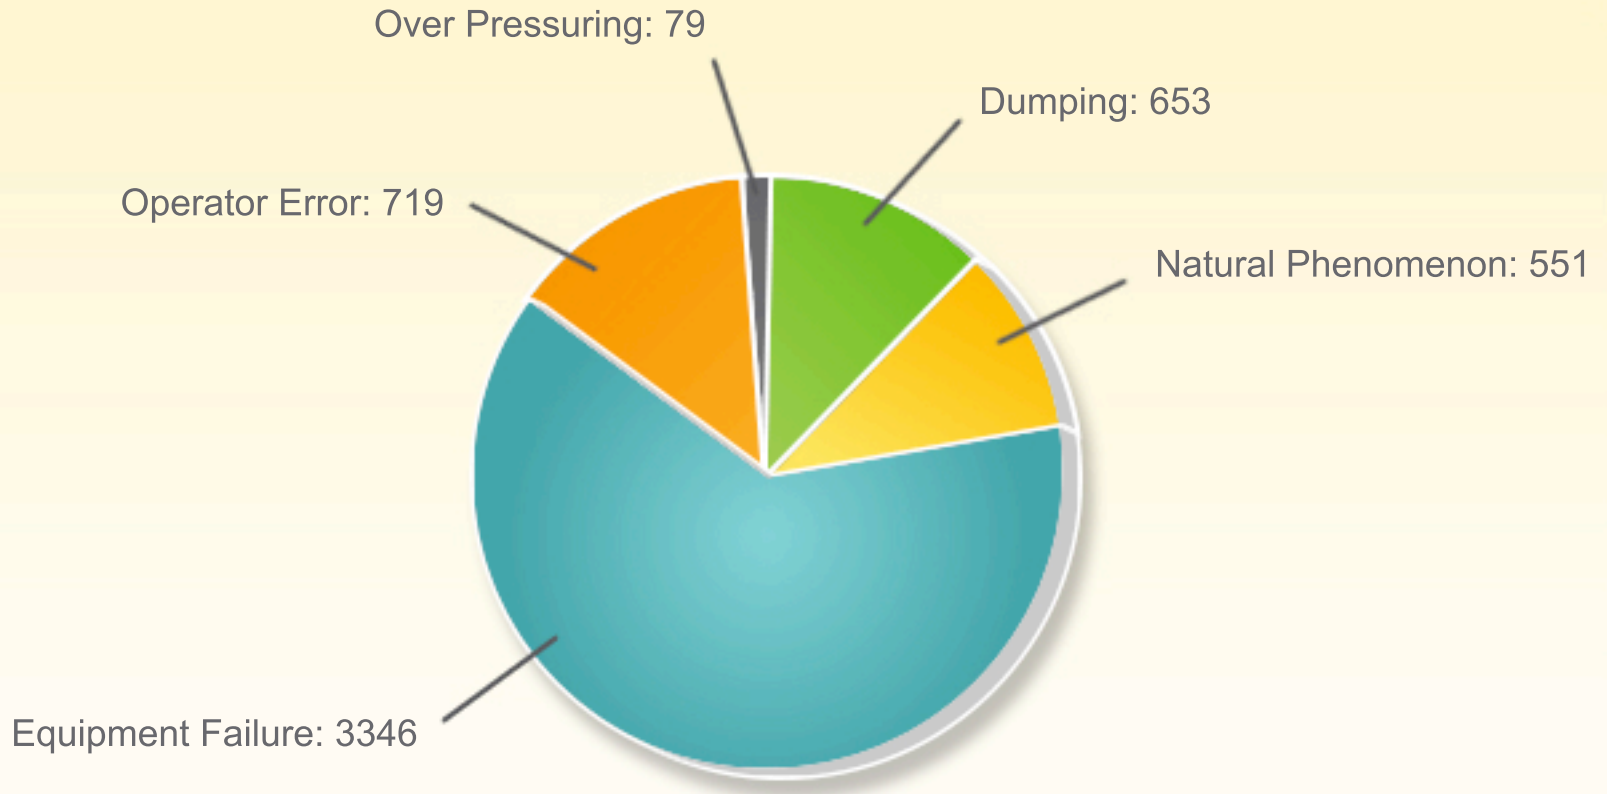

 DUMPING

 NATURAL PHENOMENON

 EQUIPMENT FAILURE

 OPERATOR ERROR

 OVER PRESSURING